

EX-PROOF SOUND LIGHT ALARM

The Gary sound-light alarms is optional device for the gas detector. It'll automatically alert with sound and light when the detected gas exceeds the standard. The product is a durable design with stainless steel, and standard threaded interface makes it compatible with other electrical equipment also.

Features


- Compact size, standard threaded interface for easy installation.
- IP66 design with all 316L stainless steel body, suitable for harsh environments.
- 360° light alarm, high loudness buzzer, effective reminder.
- Compatible with gas detectors of AIYI Technologies or separately.
- 12-28VDC wide range of power supply with anti-reverse wiring function.





Specifications

Function	
alarm method	sound and light
light color	red
light intensity	>900mcd
sound intensity	>100dB
Environment	
ingress protection	IP66
operating temperature	-40°C~70°C
operating humidity	10~95%RH non-condensing
operating pressure	80-120kPa
Electric	
power supply	12-28VDC(standard 24VDC)
power consumption	≤3W
Structure	
body material	304 stainless steel+nylon
close nipple	M26*2
weight	about 0.6kg
dimensions	φ60*70mm
Certificate	
EX	Exd II CT6 Gb

Dimensions

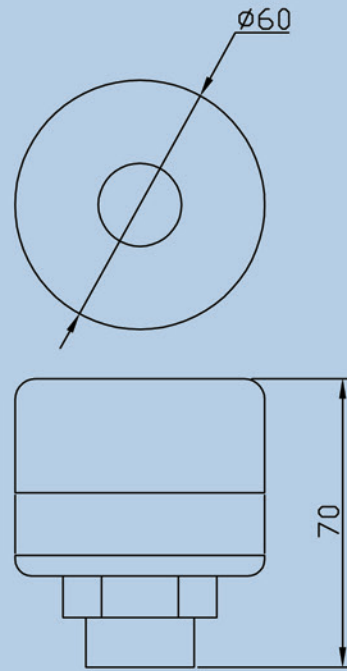

Wiring

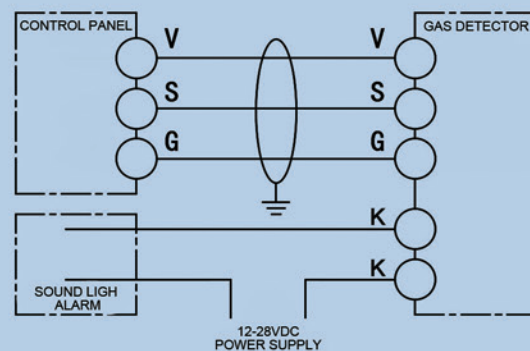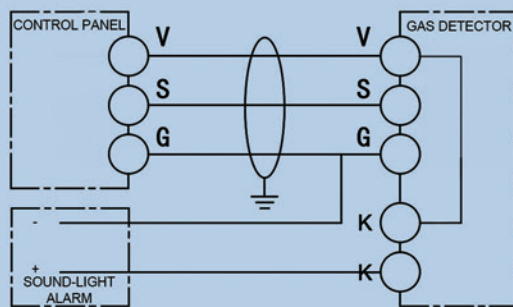



GAS DETECTION SYSTEM

Gas detection system can be widely applied in places such as petrochemical engineering, chemical engineering, steel, metallurgy, pharmaceuticals, electricity, food, and logistics where the monitoring of flammable and toxic gas is needed.

The system is made of gas detector, controller and sound-light alarm, and the gas concentration data will be uploaded to the control panel. The controller collectively displays the gas concentration data of different monitoring points, and the sound-light alarm will be set off in case that any concentration exceeds over the default value. Linkage feature can be realized and the data can be also uploaded to host systems such as DCS/IPC.

FUNCTION

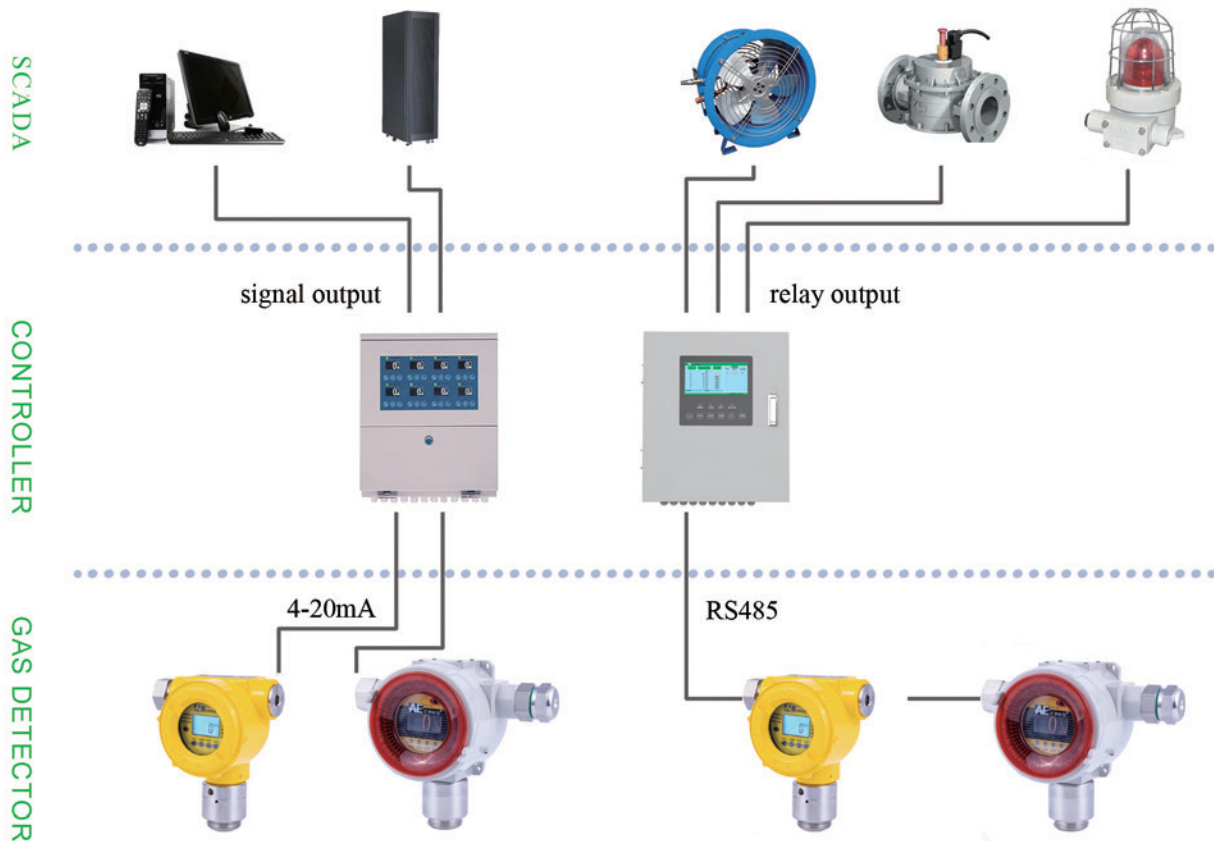


DIAGRAM of GAS DETECTION SYSTEM

1. gas detector

The gas detector is fixed in areas such as the workshop, warehouse, and storage tank for real-time monitoring of the concentration of flammable and toxic gases.

2. zone control

The controller collectively displays the gas concentration, and the sound-light alarm will be set off in case that any concentration exceeds over the default value.

3. The interlock control

It comes with relay output and fault output for the performing of automatic fan, spray, valve, and alarm.

4. The host computer

Standard 4-20mA and RS485 signal output, compatible with host computers such as DCS/PLC/IPC.



SELECTION GUIDE

QUICK SELECTION TABLE 1 -- FIXED GAS DETECTOR

Description	AG310 series					AG210 series				AG200 series		
	GTQ-AF110	GTQ-AF111	AF110-R	AG310	AG311	AG210	AG211	GTQ-Anr-A	GTQ-Anr-D	AG200	Anr-N	Anr-S
Gas detected												
combustible gas-catalytic	●	●	-	-	-	-	-	●	●	-	●	●
combustible gas-infrared	-	-	●	-	-	-	-	-	-	-	-	-
toxic gas-electrochemical	-	-	-	●	●	●	●	-	-	●	-	-
toxic gas-PID	-	-	-	●	●	●	●	-	-	●	-	-
toxic gas-infrared	-	-	-	●	●	●	●	-	-	●	-	-
toxic gas-semiconductor	-	-	-	●	●	-	-	-	-	-	-	-
Display												
OLED	●	●	●	●	●	-	-	-	-	-	-	-
LCD	-	-	-	-	-	●	●	●	●	-	-	-
Signal output												
4-20mA	●	-	●	●	-	●	-	●	-	●	●	-
RS485	-	●	-	-	●	-	●	-	●	●	-	●
Wiring												
three-wire	●	-	●	●	-	●	-	●	-	●	●	-
four-wire	-	●	-	-	●	-	●	-	●	●	-	●

Note:

1. ● means available, - means unavailable;

2. both oxygen and toxic gas are detected in electrochemical principle, so the toxic gas includes oxygen in the above table.

QUICK SELECTION TABLE 2 -- CONTROL PANEL

Description	AGS1600F	AGS1000	AGS1000B	AGS1000D	JUDD	JUDD-S
Gas detected						
combustible gas	●	●	●	●	●	●
toxic gas	-	●	●	●	●	●
Display						
LCD	●	●	●	●	-	-
OLED	-	-	-	-	●	●
Signal input						
4-20mA	●	●	●	●	●	●
RS485	-	●	●	●	-	-
Wiring						
three-wire	●	●	●	●	●	●
four-wire	-	●	●	●	-	-
Channels	4	1-64	1-64	1-64	1-8	32-128
Installation						
wall-mounted type	●	●	●	●	●	-
cabinet type	-	-	-	-	-	●
UPS	-	-	●	-	-	-
Explosion-proof	-	-	-	●	-	-

Note: The channels of AGS1000, AGS1000B, AGS1000D, JUDD, JUDD-S can be customized.

QUICK SELECTION TABLE 3 -- GAS DETECTED

Gas	Measure Range	Principle	Resolution	GTQ- AF110	GTQ- AF111	GTQ- AF110-R	GTQ- Amr-A	GTQ- Amr-D	Amr-N	Amr-S	AG310	AG311	AG210	AG211	AG200
EX	0-100%LEL	Catalytic	1%LEL	●	●	-	●	●	●	●	-	-	-	-	-
Combustible gas	0-100%LEL	Catalytic	1%LEL	-	-	●	-	-	-	-	-	-	-	-	-
EX	0-100%LEL	Infrared	1%LEL	-	-	-	-	-	-	-	-	-	-	-	-
O ₂	0-30%VOL	Electrochemical	0.1%VOL	-	-	-	-	-	-	-	●	●	●	●	●
Carbon monoxide	0-1000µmol/mol	Electrochemical	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Hydrogen sulphide	0-100µmol/mol	Electrochemical	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Chlorine	0-10µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Sulphur dioxide	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Ammonia	0-100µmol/mol	Electrochemical	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Nitric oxide	0-250µmol/mol	Electrochemical	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Nitrogen dioxide	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Hydrogen chloride	0-30µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Ozone	0-1µmol/mol	Electrochemical	0.01µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Ethylene oxide	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Formaldehyde	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Methanol	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Phosphine	0-5µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Hydrogen	0-1000µmol/mol	Electrochemical	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Fluorine	0-1µmol/mol	Electrochemical	0.01µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Hydrogen fluoride	0-10µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Hydrogen cyanide	0-50µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Phosgene	0-1µmol/mol	Electrochemical	0.01µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Arsenic hydride	0-1/20µmol/mol	Electrochemical	0.01µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Silane	0-50µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Acrylonitrile	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Carbon disulfide	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Ethanol	0-20µmol/mol	Electrochemical	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Sulfur hexafluoride	0-1000µmol/mol	Infrared	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Methane	0-5%/100%VOL	Infrared	0.1%VOL	-	-	-	-	-	-	-	●	●	●	●	●
Carbon dioxide	0-5%/100%VOL	Infrared	0.1%VOL	-	-	-	-	-	-	-	●	●	●	●	●
Toluene	0-20µmol/mol	PID	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Xylene	0-20µmol/mol	PID	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Benzene	0-20µmol/mol	PID	0.1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Acetic acid	0-1000µmol/mol	PID	1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●
Volatile organic compounds	0-20µmol/mol 0-1000µmol/mol	PID	0.1µmol/mol 1µmol/mol	-	-	-	-	-	-	-	●	●	●	●	●

Note: 1. Any gas that not mentioned above, just contact AIYI Technologies for further information; 2. 1µmol/mol=1ppm



OFFICIAL WEBSITE



AIYI Technologies

TEL: 0086-25-87787361 FAX: 0086-25-87787362
WEB: www.AIYITEC.com EMAIL: sales@autequ.com

Authorized Distributor:

Disclaimer: All pictures, configurations and parameters in this document are for reference only. There may be differences with the actual products. Any difference is subject to the latest real products.